WALL LEGEND:

- 1-HR FIRE BARRIER, U356
- 1-HR FIRE PARTITION
- 2-HR WALL

TAGGED NOTES:

1. PROVIDE A HEAT DETECTOR WITHIN 2'-0" OF EVERY SPRINKLER HEAD IN THE ELEVATOR SHAFT AND EQUIPMENT ROOM.

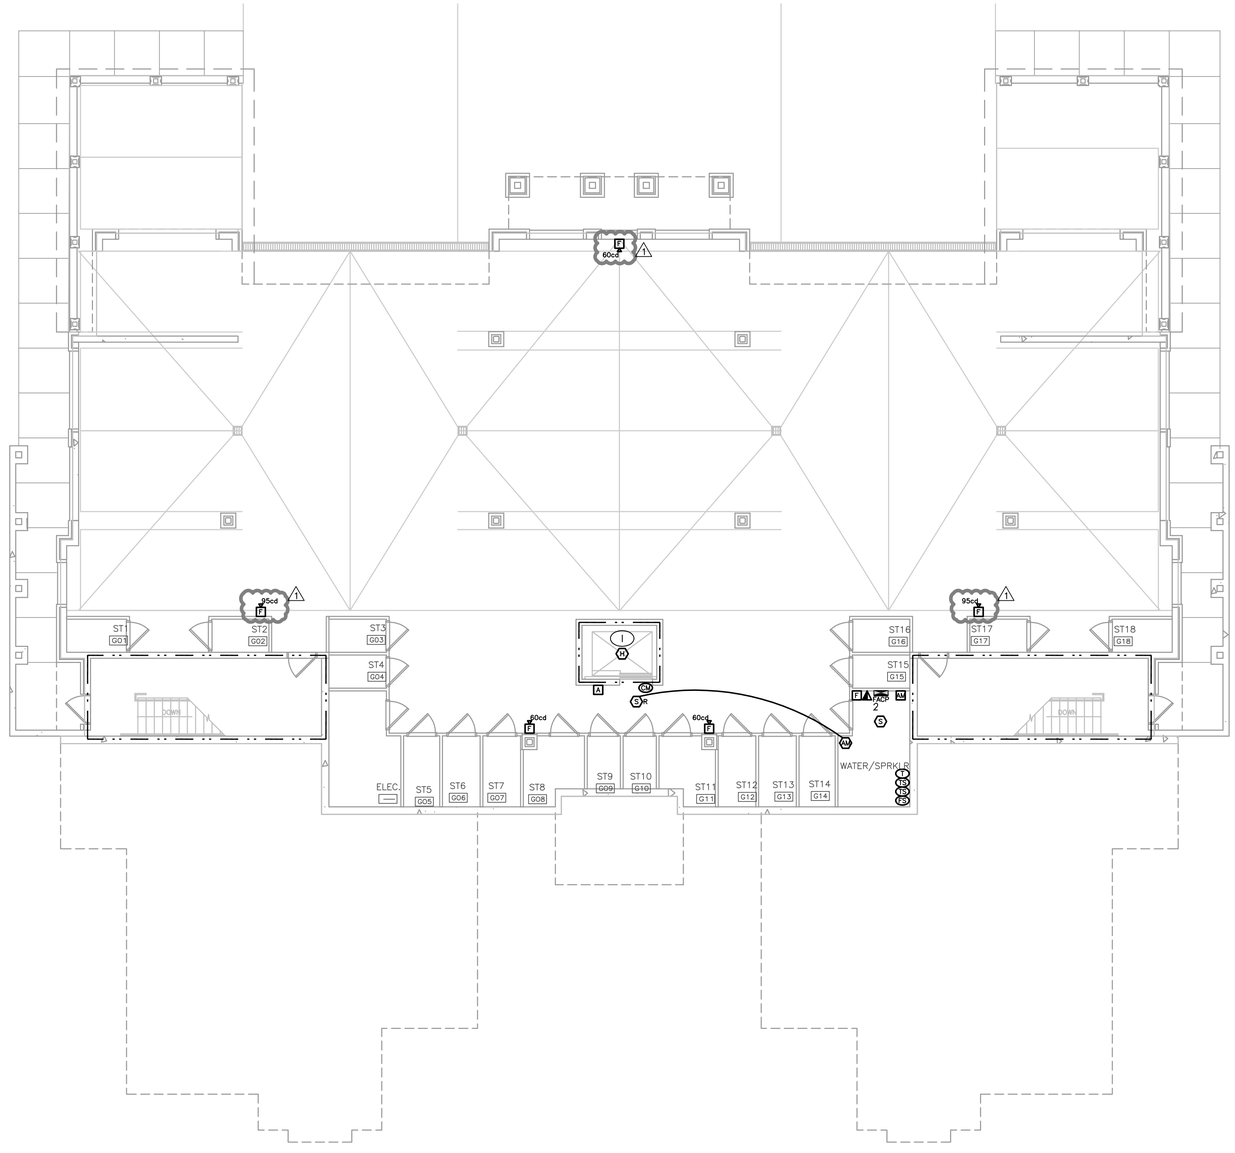

1 BASEMENT GARAGE LEVEL
1/8" = 1'-0"

©2016 LIGHTHOUSE ENGINEERING, PA EXPRESSLY RESERVES ITS COMMON LAW COPYRIGHT AND OTHER PROPERTY RIGHTS IN THESE PLANS. THESE PLANS ARE NOT TO BE REPRODUCED, CHANGED OR COPIED IN ANY FORM OR MANNER WHATSOEVER, NOR ARE THEY TO BE ASSIGNED TO ANY THIRD PARTY WITHOUT FIRST OBTAINING THE EXPRESSED WRITTEN PERMISSION AND CONSENT OF LIGHTHOUSE ENGINEERING, PA

JDAVIS
510 S. Wilmington Street | Raleigh, North Carolina 27601 | tel 919.835.1500 | fax 919.835.1510

LIGHTHOUSE ENGINEERING
400 W. Morgan Street, Suite 100
Raleigh, North Carolina, 27603
tel 919.835.9781
fax 919.835.9754
MECHANICAL ELECTRICAL PLUMBING

Concordia Building Company
Nantucket Condominiums
700 Waterford Lake Drive Cary, NC

NORTH CAROLINA PROFESSIONAL SEAL 26585 ENGINEER PAUL S. SCOTT
08/09/17

		DATE
PROJECT:	WOP-05115	06.16.2017
REVISIONS:		
1	CITY COMMENTS	08.07.17
DRAWN BY:	PSS	
CHECKED BY:	PSS	
CONTENT:	FIRE ALARM	
	BUILDING PLAN	

FA2.00